


REDUCED PRESSURE ZONE

RPZ BACKFLOW

Installation Instructions

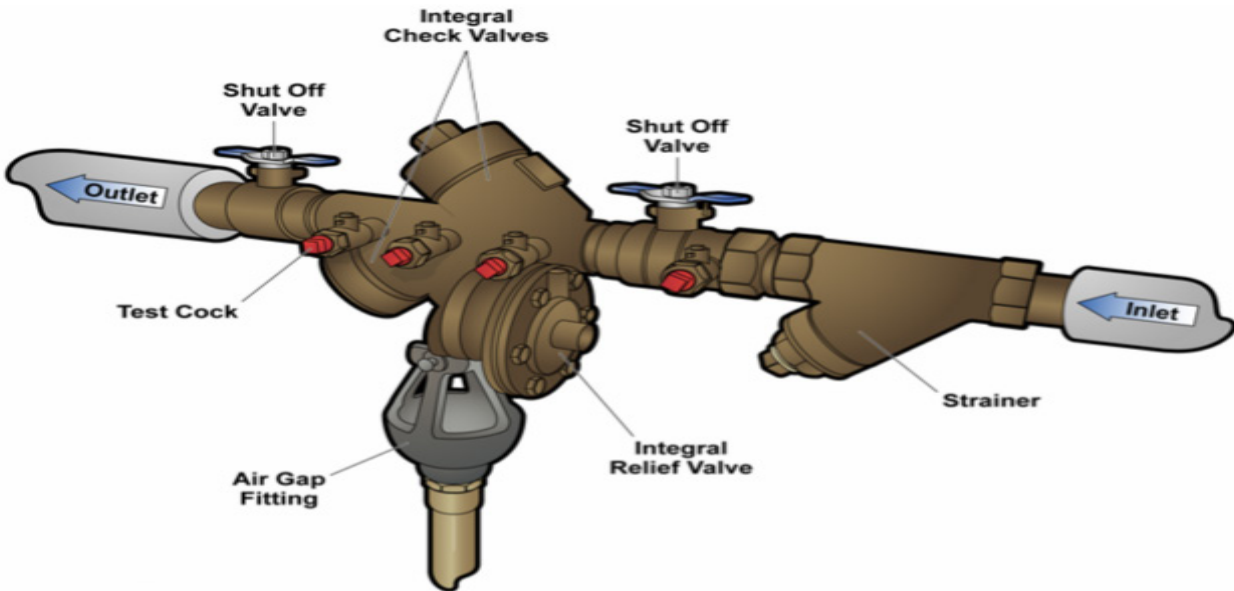

Horizontal Installation: The City of Fayetteville requires the following clearances at the backflow preventer:

The bottom of the assembly shall be a minimum of **12** inches from ground and a maximum of **36** inches from finished floor level. The test cock side of the assembly shall be a minimum of **10** inches from any obstruction. The rear of the assembly shall be a minimum of **10** inches from any obstruction. The shutoff valves shall be installed a minimum of **8** inches from any obstruction. The highest point of the backflow preventer shall be installed a minimum of **10** inches from any obstruction.

Vertical Installation: The City of Fayetteville requires the following clearances at the backflow preventer:

12 inches minimum and **24** inches maximum from the finished floor to shut-off valve #1. **24** inches minimum on the front (test cock side) from any obstruction. **12** inches minimum both sides and back from any obstruction.

